


PLAN

CAP TO BE SET AT FINISHED GRADE.
 CAP IS TO BE AN ASTM 3034 SDR 26
 (6") PVC PUSH ON CAP. GASKET SHALL
 BE REMOVED FROM CAP.

NOTE: TWO (2) "TEE" BOLTS, THREE (3)
 INCHES LONG MIN., SHALL BE ATTACHED
 WITH A STRIP OF DUCT TAPE TO THE
 CLEANOUT CAP, ONE (1) INCH BELOW
 THE CAP.

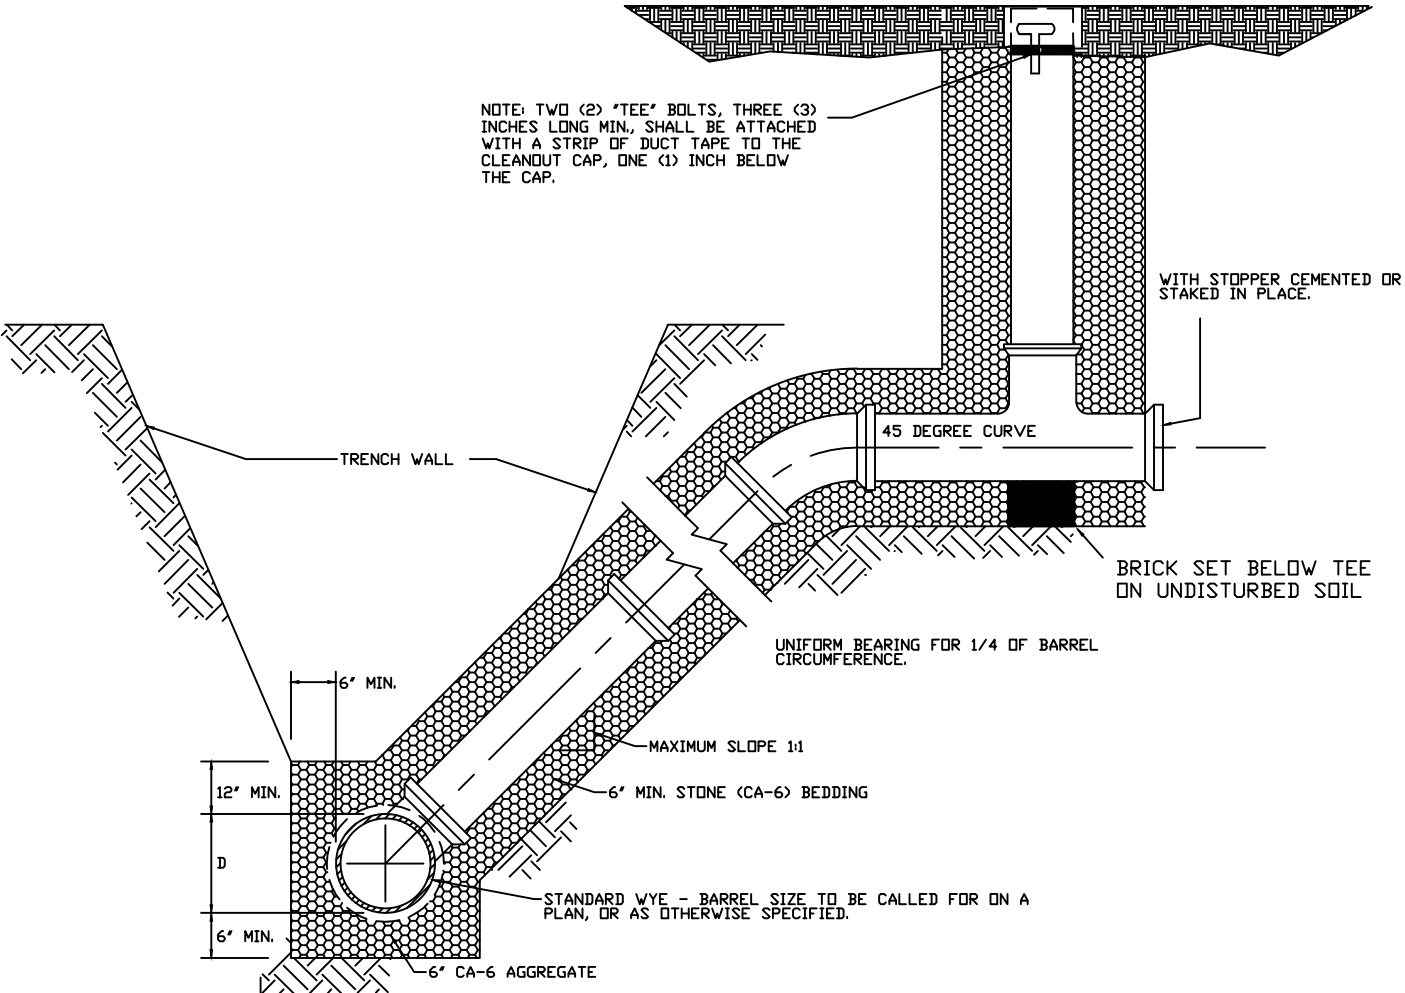

SECTION A-A

REV.:	CJW	REV.:	11-05-2009
REV.:	ERH	REV.:	8-07-09
DRAWN BY:	VJGL	DATE:	2-16-98

RISER W/CLEANOUT
 SERVICE LATERAL

CITY OF WOOD DALE
 SANITARY 4

GENERAL NOTES:

1. THE OPEN ENDS SHALL BE PROTECTED FROM DEBRIS ENTERING THE LATERAL.
2. MAXIMUM SLOPE SHALL BE LESS THAN 1 TO 1 WHEN IT IS NECESSARY TO SECURE BEDDING IN UNDISTURBED EARTH.
3. WHEN SERVICE CONNECTION REQUIRES CORING AN EXISTING MAIN, A SEWER SADDLE SHALL BE USED. CLOW TYPE SHALL BE "SEALTITE" OR APPROVED EQUAL. BANDS AND BOLTS SHALL BE STAINLESS STEEL.
4. SERVICE TEE AND CLEAN OUT RISER SHALL BE PVC (SDR26/ASTM D2241). FOR CLEAN OUTS LOCATED WITHIN LANDSCAPED AREAS, THE CONTRACTOR SHALL USE P1215 DWV BUSHING AND G106 CAP MANUFACTURED BY PLASTIC TRENDS, INC (ASTM 3034). GASKET SHALL BE REMOVED FROM CAP.
5. CLEAN OUTS SHALL NOT BE LOCATED IN DRIVEWAY APRONS OR SIDEWALK UNLESS APPROVED BY THE PUBLIC WORKS DIRECTOR IF ALLOWED, THE CONTRACTOR SHALL USE SCHEDULE 40 DWV FIPT HUB ADAPTER AND THE RAISED MIPT PLUG (ASTM D 2665 OR ASTM D 1785) AND AN EAST JORDAN FRAME (2885) AND LID (2975). EQUIVALENT FITTINGS FROM OTHER MANUFACTURES ARE ACCEPTABLE AT THE DISCRETION OF THE PUBLIC WORKS DIRECTOR. WRITTEN ACCEPTANCE MUST BE OBTAINED PRIOR TO THE EQUIVALENT MATERIALS BEING APPROVED. GEOMETRIC STANDARDS CANNOT BE VARIED.

REV.:	REV.:
REV.:	REV.:
DRAWN BY:	DATE: 4-3-18

SANITARY RISER FOR
SERVICE LATERAL

CITY OF WOOD DALE
SANITARY 4A